



Public Works Department

433 N. Virginia Street
Prescott AZ 86301
928-777-1130

**ADDENDUM NUMBER TWO
to the
PROJECT SPECIFICATIONS
and
CONTRACT DOCUMENTS
for
FY 2016 Sidewalks Repair Project**

DATE OF ADDENDUM: June 23, 2015

TO ALL BIDDERS BIDDING ON THE ABOVE PROJECT:

The following addendum shall be made part of the Contract Documents. All other provisions of the Contract Documents remain unchanged. The Bidder shall acknowledge receipt of this Addendum by signing below and returning with the bid package. The contents of this Addendum shall be given full consideration in the preparation of the Bid.

Page 5 of 5 Plans: Standard Details Typical Details

Delete: Page 5 of 5 "Standard Details Typical Details"

Insert: Revised Page 5 of 5 "Standard Details Typical Details"

- END -

City of Prescott, Public Works Department


Henry Hash, Public Works Director

6-23-15






Acknowledgement: (must be signed and turned in with the bid documents)

Company Name

Date


Signature of Company Official

Date

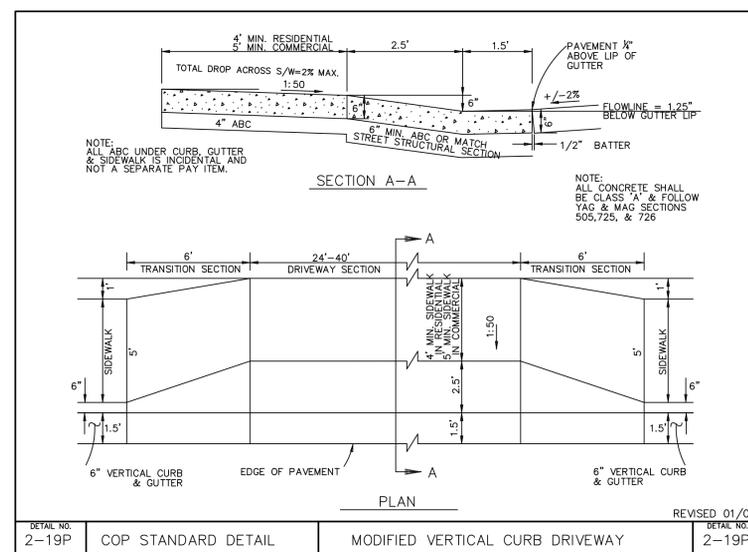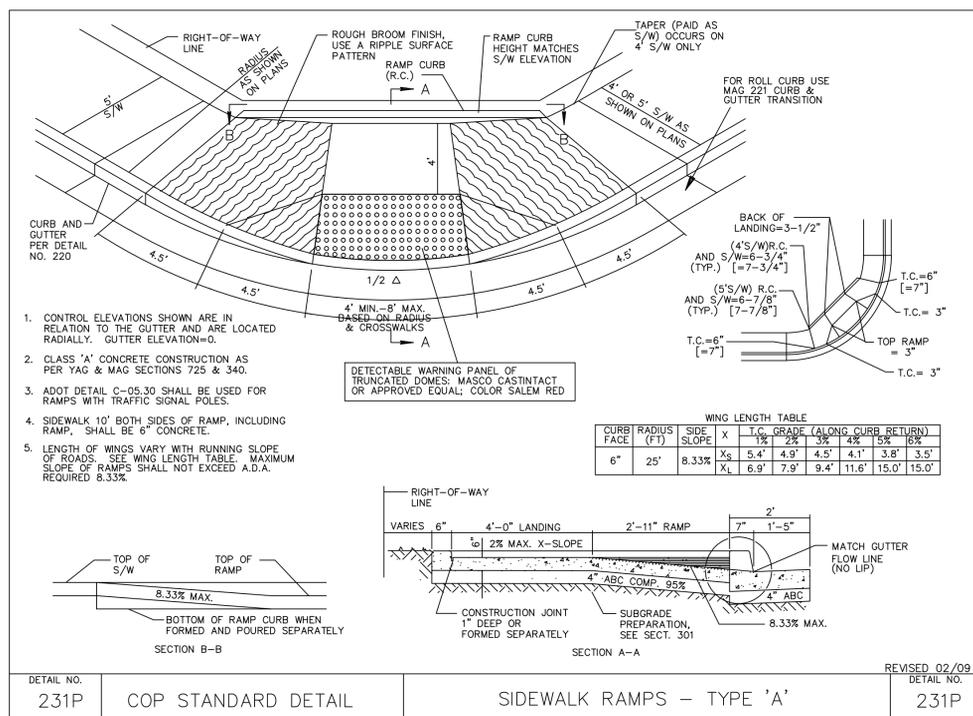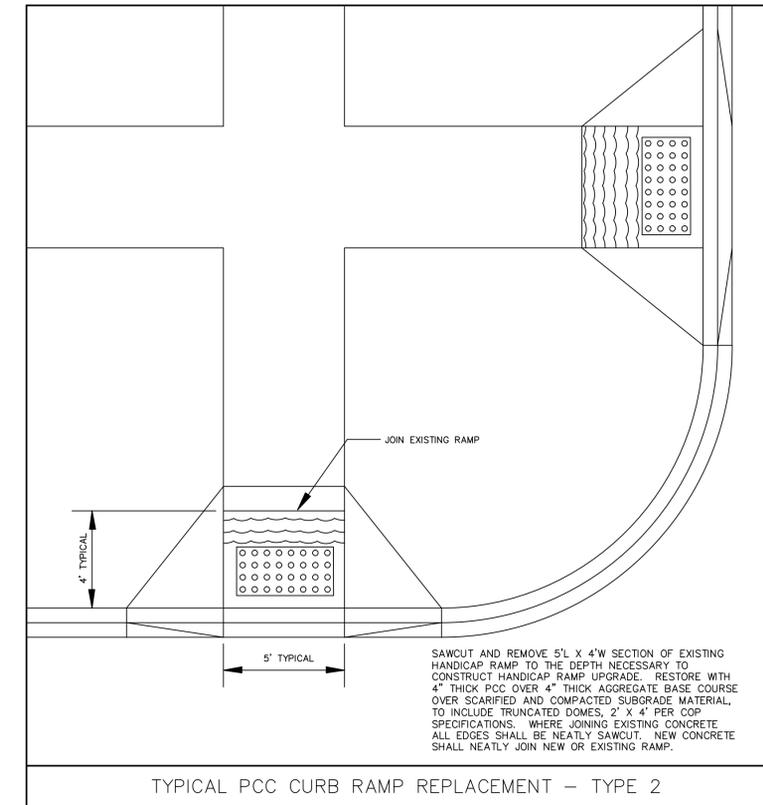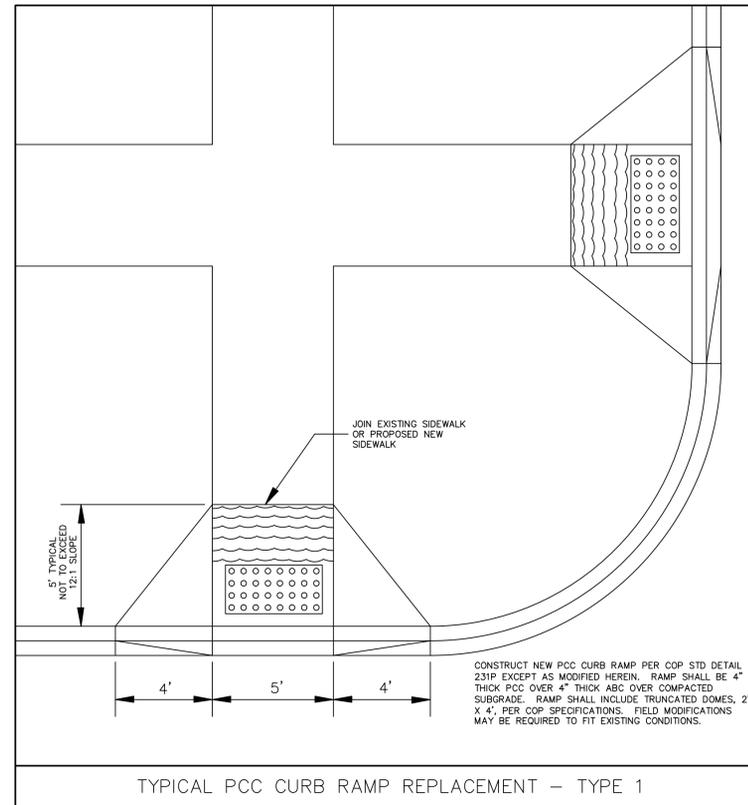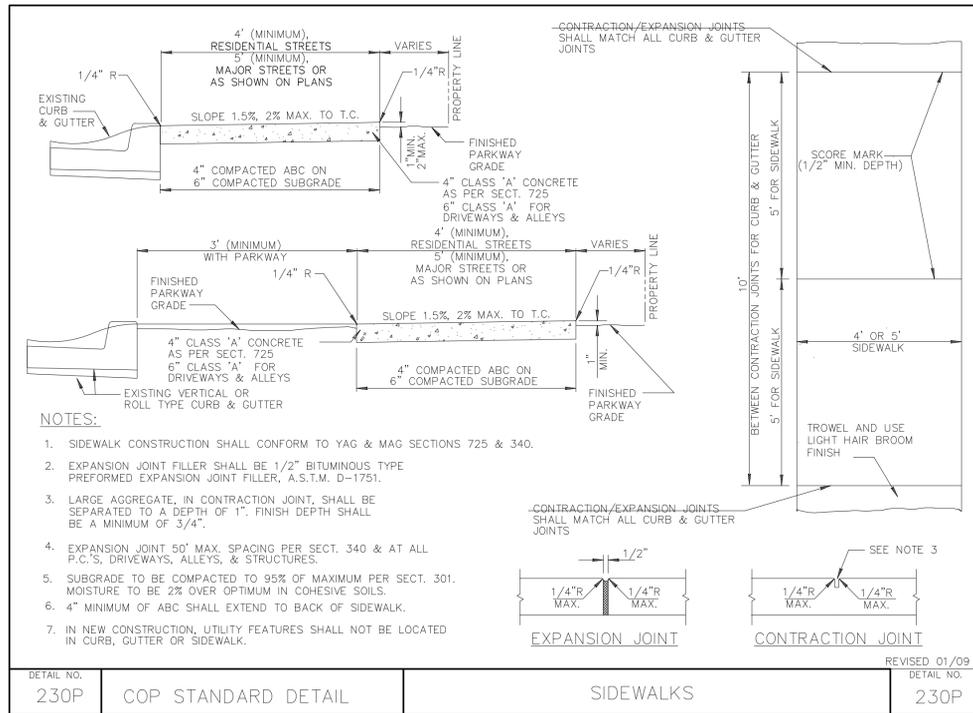

SIDEWALK REPAIRS CONSTRUCTION NOTES:

- SIDEWALK REPAIR TYPE 1: REMOVE EXISTING CONCRETE SIDEWALK, BASE MATERIAL, AND SUBGRADE MATERIAL TO THE DEPTH NECESSARY TO CONSTRUCT NEW PCC SIDEWALK PER COP STANDARD DETAIL 230P. CONSTRUCT NEW 4" THICK PCC SIDEWALK OVER 4" THICK AGGREGATE BASE COURSE OVER SCARIFIED AND COMPACTED SUBGRADE MATERIAL. SIDEWALK SHALL BE RESTORED TO ORIGINAL LINE AND GRADE EXCEPT AS MODIFIED BY THE COP REPRESENTATIVE TO PROVIDE A SMOOTH AND EVEN SURFACE. WHERE JOINING EXISTING CONCRETE ALL EDGES SHALL BE NEATLY SAWCUT. NEW CONCRETE SHALL NEATLY JOIN EXISTING SIDEWALK. APPROXIMATE DIMENSIONS ARE SHOWN ON THE PLANS.
- SIDEWALK REPAIR TYPE 2: BY GRINDING OR BY PRECISION HORIZONTAL SAWCUTTING ELIMINATE VERTICAL DISPLACEMENT IN SIDEWALK PANELS PER THE DETAIL SHOWN ON SHEET 5. RESULTING SURFACE SHALL BE SMOOTH TO THE SATISFACTION OF THE ENGINEER.
- PCC CURB RAMP REPLACEMENT - TYPE 1: REMOVE EXISTING CONCRETE HANDICAP RAMP, BASE MATERIAL, SUBGRADE MATERIAL AND OTHER OBSTRUCTIONS TO THE DEPTH NECESSARY TO CONSTRUCT NEW PCC HANDICAP RAMP. CONSTRUCT NEW 4" THICK PCC HANDICAP RAMP OVER 4" THICK AGGREGATE BASE COURSE OVER SCARIFIED AND COMPACTED SUBGRADE MATERIAL, TO INCLUDE TRUNCATED DOMES. WHERE JOINING EXISTING CONCRETE ALL EDGES SHALL BE NEATLY SAWCUT. NEW CONCRETE SHALL NEATLY JOIN NEW OR EXISTING SIDEWALK. CONSTRUCT PER COP STD DETAIL 231P MODIFIED TO FIT EXISTING CONDITIONS AND AS MODIFIED HEREIN. SEE DETAIL ON SHEET 5.
- PCC CURB RAMP REPLACEMENT - TYPE 2: SAWCUT AND REMOVE 5'L X 4'W SECTION OF EXISTING HANDICAP RAMP TO THE DEPTH NECESSARY TO CONSTRUCT HANDICAP RAMP UPGRADE. RESTORE WITH 4" THICK PCC OVER 4" THICK AGGREGATE BASE COURSE OVER SCARIFIED AND COMPACTED SUBGRADE MATERIAL, TO INCLUDE TRUNCATED DOMES. ALL JOINTS TO EXISTING CONCRETE SHALL BE NEATLY SAWCUT. NEW CONCRETE SHALL NEATLY JOIN NEW OR EXISTING RAMP. CONSTRUCT PER COP STD DETAIL 231P MODIFIED TO FIT EXISTING CONDITIONS AND AS MODIFIED HEREIN. SEE DETAIL ON SHEET 5.

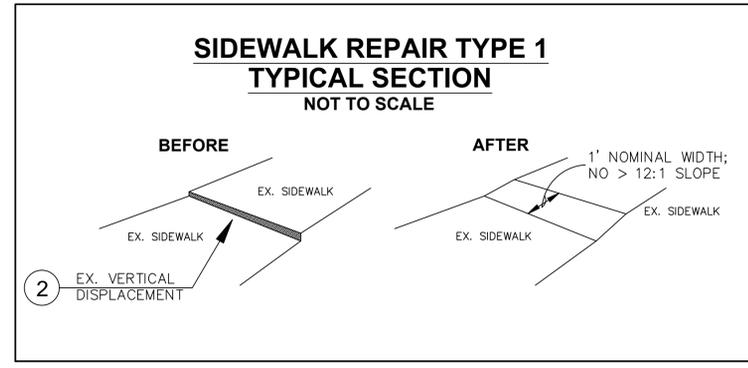

CITY OF PRESCOTT PUBLIC WORKS
 433 NORTH VIRGINIA STREET
 PRESCOTT, ARIZONA 86301 (928) 777-1130

FY 2016 SIDEWALKS REPAIR PROJECT

STANDARD DETAILS TYPICAL DETAILS

DRAWN GH
 DESIGN GH
 CHECKED
 FIELD BOOK
 SHEET 5 of 5
 CIP15-024