




PRESCOTT FIRE DEPARTMENT

GUARD POST DETAIL

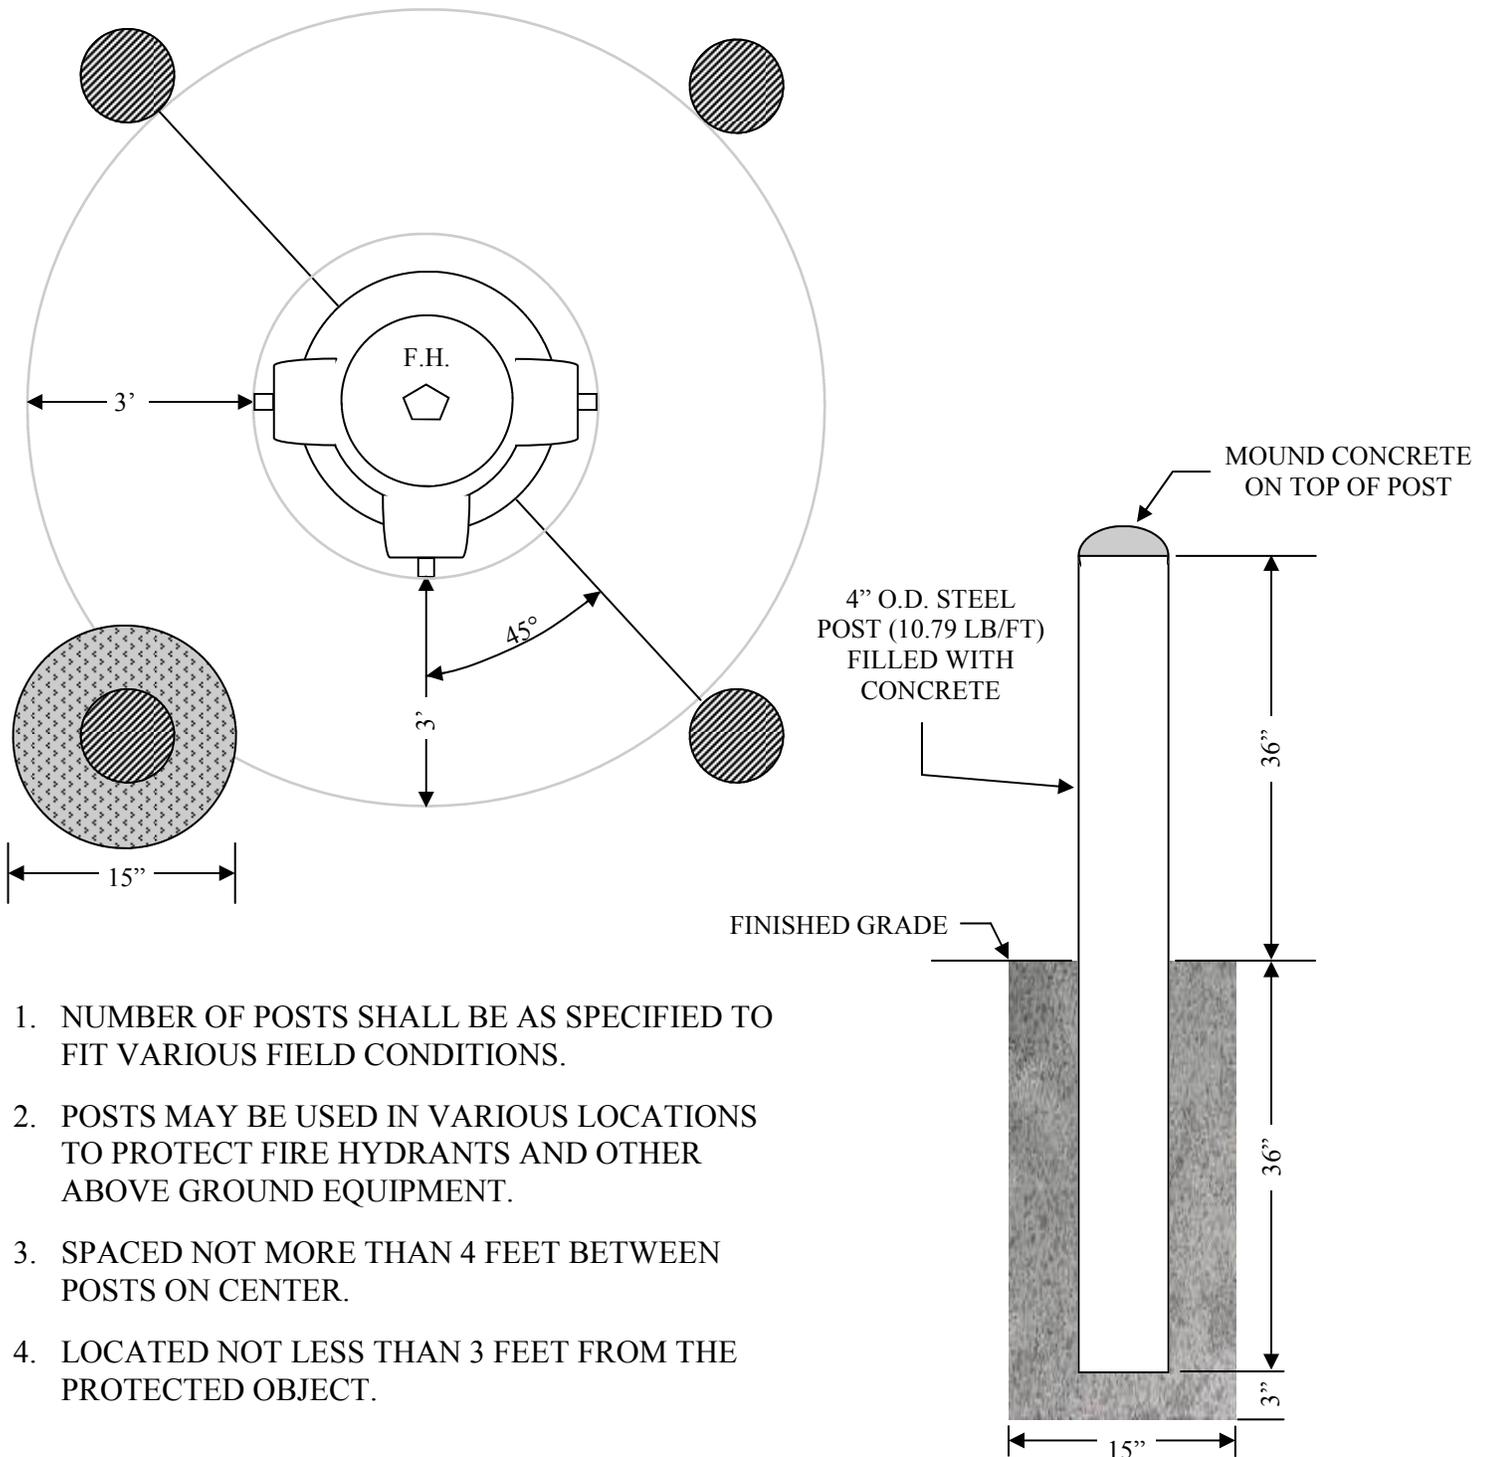

1. NUMBER OF POSTS SHALL BE AS SPECIFIED TO FIT VARIOUS FIELD CONDITIONS.
2. POSTS MAY BE USED IN VARIOUS LOCATIONS TO PROTECT FIRE HYDRANTS AND OTHER ABOVE GROUND EQUIPMENT.
3. SPACED NOT MORE THAN 4 FEET BETWEEN POSTS ON CENTER.
4. LOCATED NOT LESS THAN 3 FEET FROM THE PROTECTED OBJECT.