


## Quarterly Arsenic Results

Each year the City of Prescott is required to pull quarterly Arsenic samples at EPDS (Entry Point to Distribution System) 011 located in Chino Valley. This sample is taken to ensure Arsenic levels stay below Federal and State regulatory limits. The MCL (Maximum Contaminant Level) for Arsenic in drinking water is 10 ppb (Parts Per Billion). Below are the quarterly results for the most recent year of City of Prescott Arsenic testing. More information about Arsenic can be found at [http://legacy.azdeq.gov/enviro/water/dw/download/epa\\_arsenic.pdf](http://legacy.azdeq.gov/enviro/water/dw/download/epa_arsenic.pdf)

## Quarterly Arsenic Results

Quarter	Level
2022 Q1	7.0 ppb
2021 Q4	7.7 ppb
2021 Q3	8.0 ppb
2021 Q2	8.1 ppb

\*MCL is 10.0 ppb

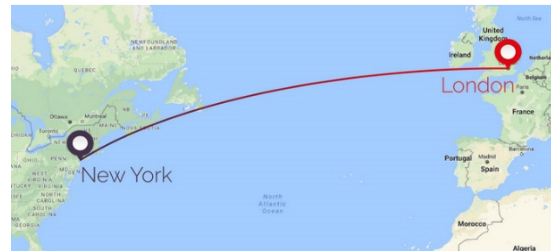

One ppb is like: One sheet in a roll of toilet paper stretching from New York to London